


CALL BEFORE YOU DIG
 1-800-424-5555
"IT'S THE LAW"

FINAL GRADE

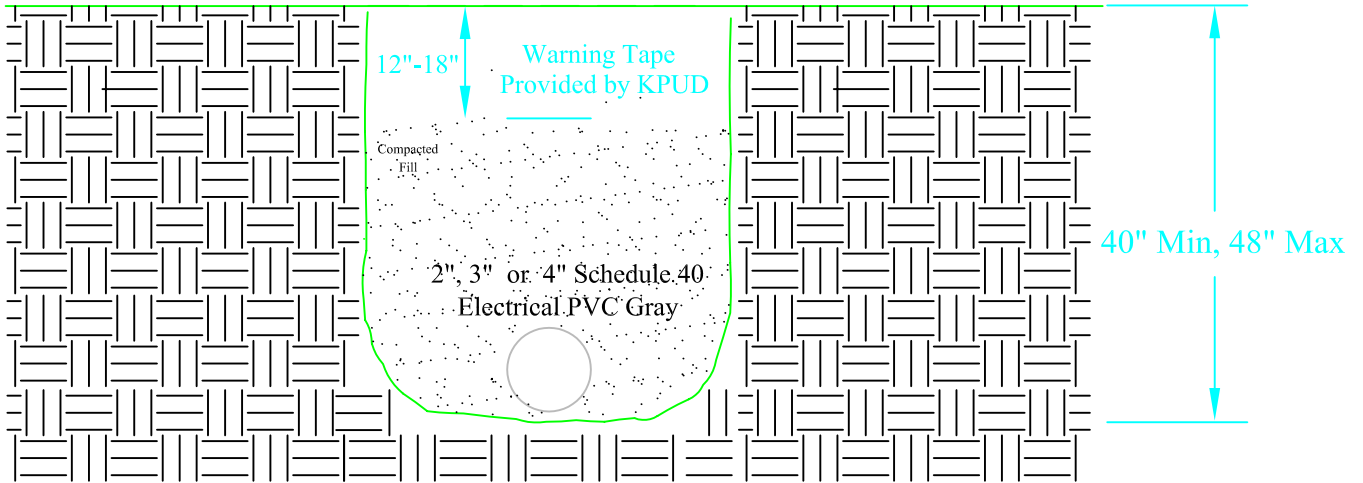

- RED WARNING TAPE TO BE INSTALLED ABOVE CONDUIT AT 12" TO 18" BELOW FINISHED GRADE
- ALL PRIMARY (HIGH VOLTAGE) CONDUIT AND WIRE SHALL BE INSTALLED BY KPUD
- A 20" HORIZONTAL SEPARATION REQUIRED BETWEEN KPUD CONDUCTOR AND WATER, SEWER OR GAS LINES
- CONDUIT TO BE CONTINUOUSLY SUPPORTED BY TRENCH BOTTOM (NO HIGH OR LOW AREAS)
- TRENCH NO CLOSER THAN 24" TO A POLE OR VAULT
- TRENCH NOT TO EXCEED MAXIMUM DEPTH SHOWN

REVISION: 08/20/2008		<h1 style="text-align: center;">KLICKITAT COUNTY PUD</h1>	M8-UG_PT
DRAWN BY: Amy Wiedemeier APPROVED BY: R. Zacharski			